


NOTE: ONLY POWER SERVICE DROP LOOP CONDUCTORS SHALL BE PERMITTED TO BE ATTACHED TO A SERVICE MAST (PER NEC SECTION 230-28 OR LATEST ARTICLE)

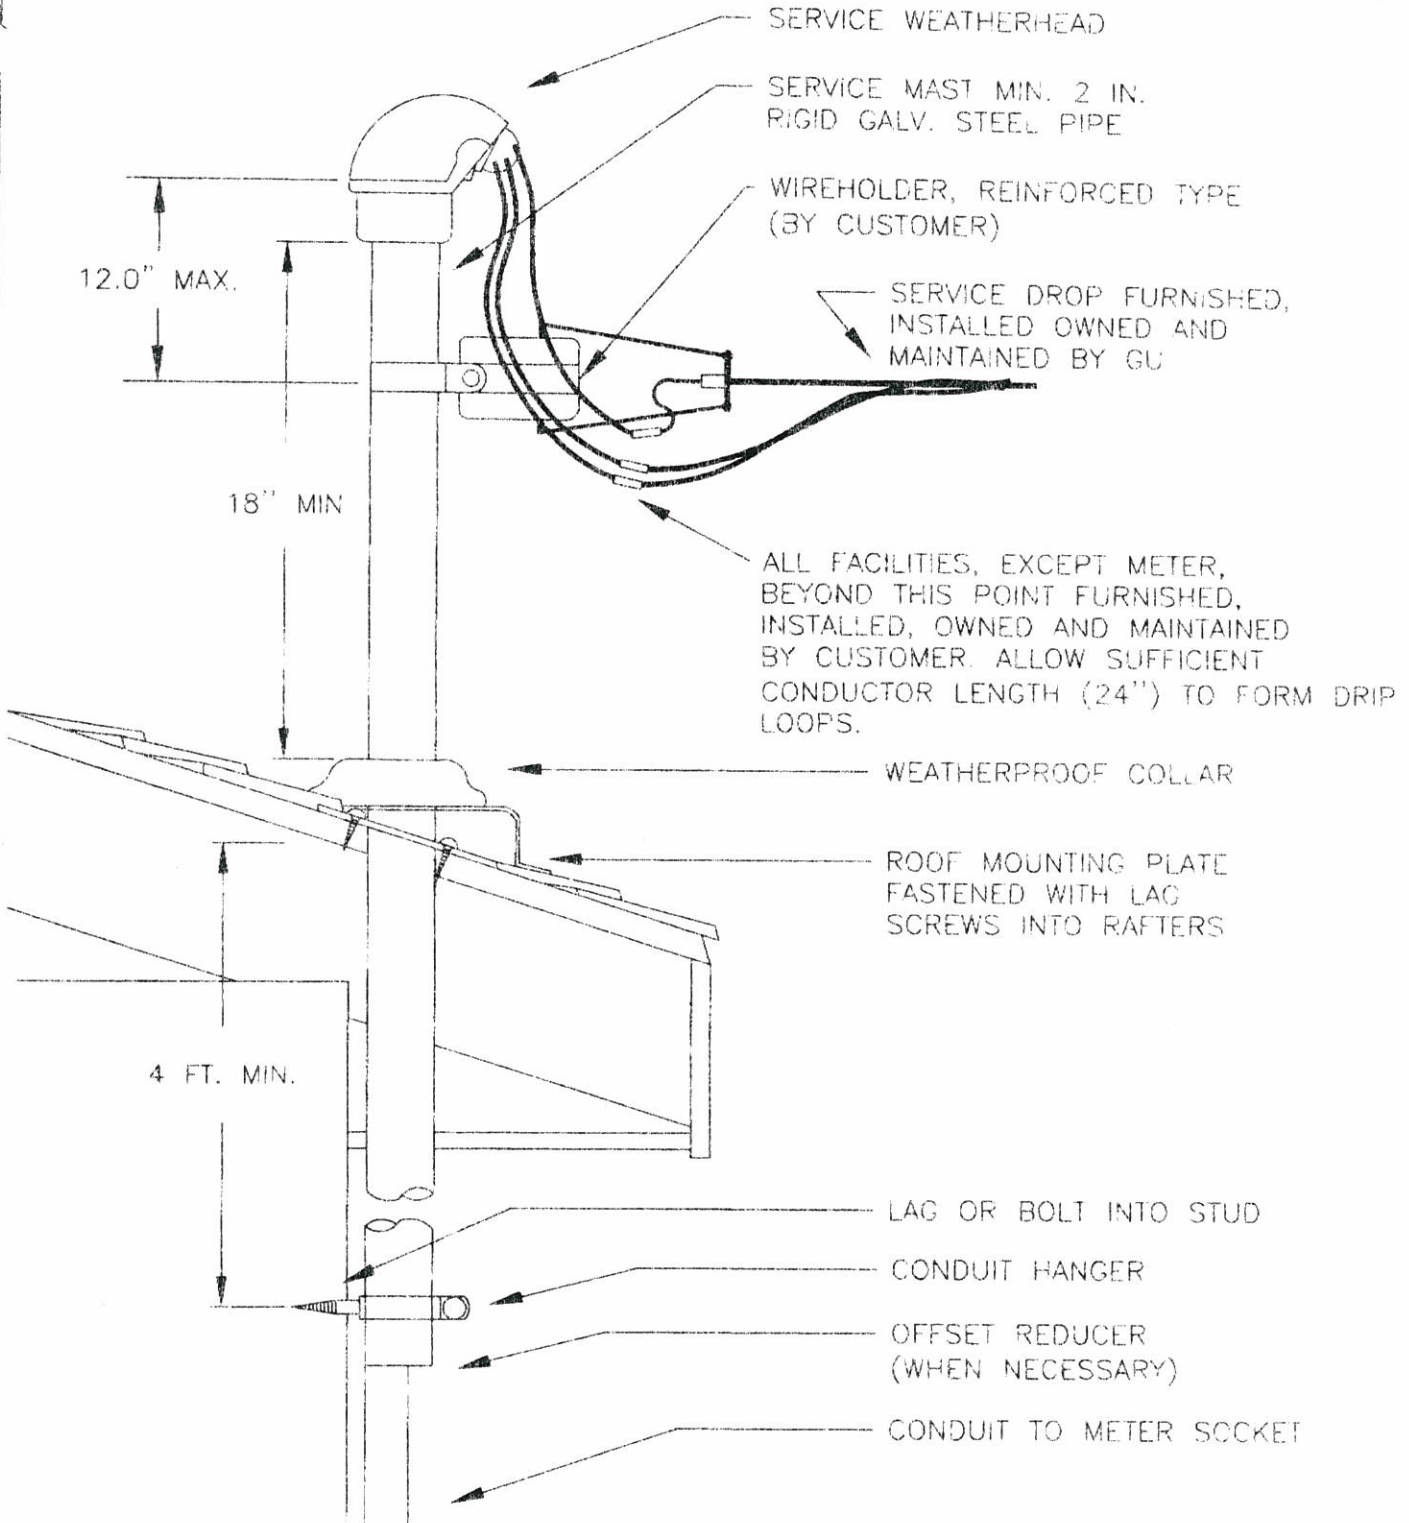

STANDARDS/ELECTRIC STANDARDS NEW FORMATS/AL SPRINGFIELD, IL 62002-2098 3/14/2005 4:14:23 PM

03/07/05

SERVICE MAST

CONSTRUCTION STANDARD

E 14.300